

AC axial fan

straight blades (A series)

ASIA PACIFIC SHENGRUI LIMITED
Phone +00852 56261528
info@apacfan.com
www.apacfan.com

Nominal data

Type	A2E200-AF05-15		
Motor	M2E068-CA		
Phase		1~	1~
Nominal voltage	VAC	230	230
Frequency	Hz	50	60
Type of data definition		fa	fa
Valid for approval / standard		CE	CE
Speed	min ⁻¹	2650	3030
Power input	W	51	63
Current draw	A	0.25	0.28
Motor capacitor	μF	1.5	1.5
Capacitor voltage	VDB	400	400
Max. ambient temperature	°C	75	85
Starting current	A	0.52	0.51

ml = max. load · me = max. efficiency · fa = running at free air · cs = customer specs · cu = customer unit
Subject to alterations



AC axial fan

straight blades (A series)

Technical features


Mass	1.3 kg
Size	200 mm
Material of impeller	Sheet steel, hot-dip galvanised
Number of blades	5
Direction of air flow	"V"
Direction of rotation	Counter-clockwise, seen on rotor
Type of protection	IP 44
Insulation class	"B"
Humidity class	F2-2
Max. permissible ambient motor temp. (transp./ storage)	+ 80 °C
Min. permissible ambient motor temp. (transp./storage)	- 40 °C
Mounting position	Any
Condensate discharge holes	None
Operation mode	S1
Motor bearing	Ball bearing
Touch current acc. IEC 60990 (measuring network Fig. 4, TN system)	< 0.75 mA
Motor protection	Thermal overload protector (TOP) wired internally
Cable exit	Variable
Product conforming to standard	EN 60335-1; CE



AC axial fan


straight blades (A series)

Product drawing

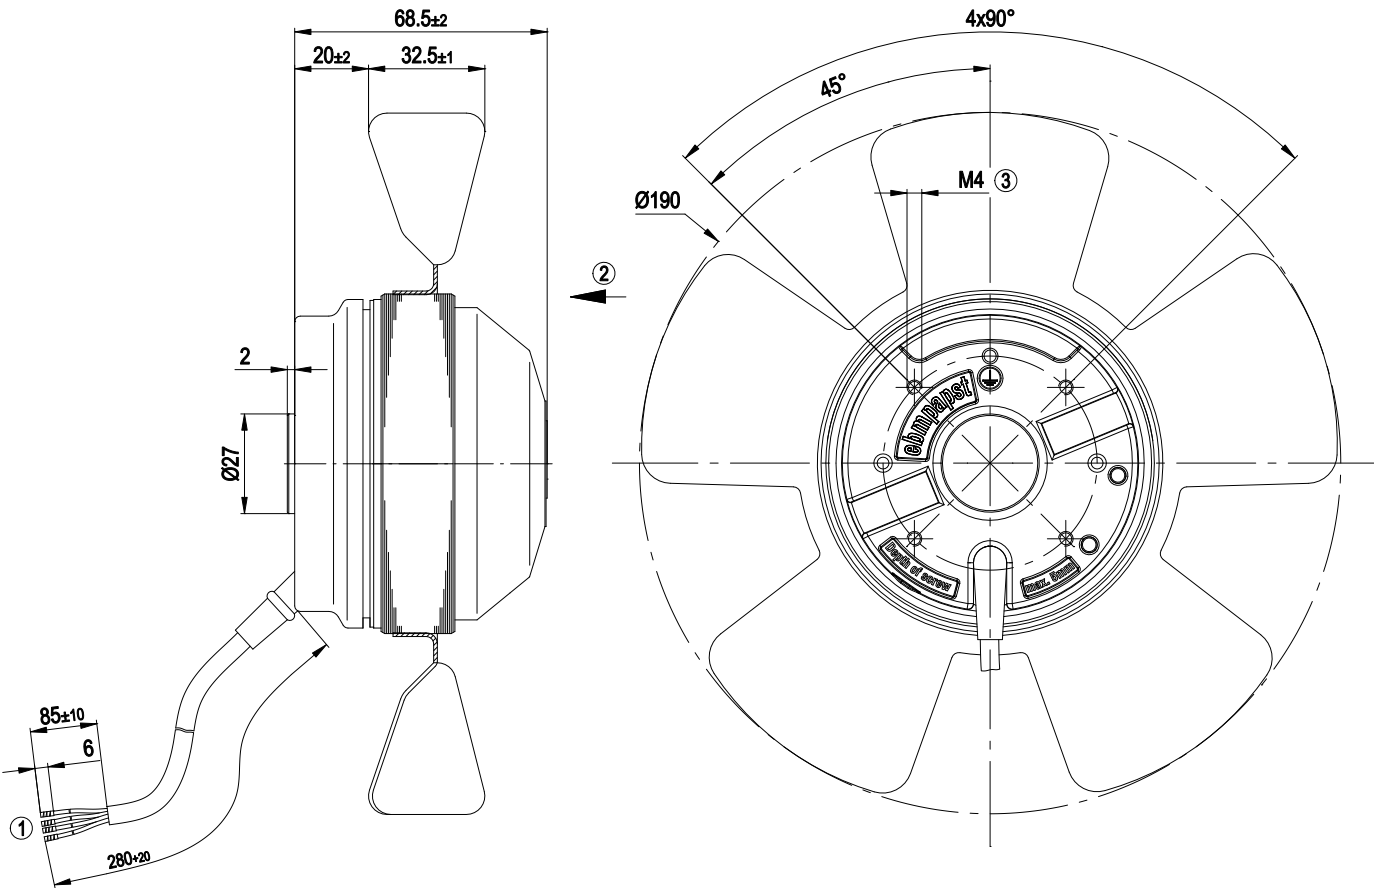

1	Connection line PFA, 4x brass lead tips crimped
2	Direction of air flow "V"
3	Screw depth max. 5 mm

Connection screen

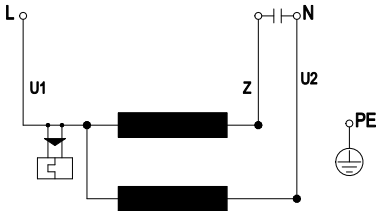


U1	blue	Z	brown	U2	black
PE	green/yellow				



AC axial fan
straight blades (A series)

Charts: Air flow 50 Hz

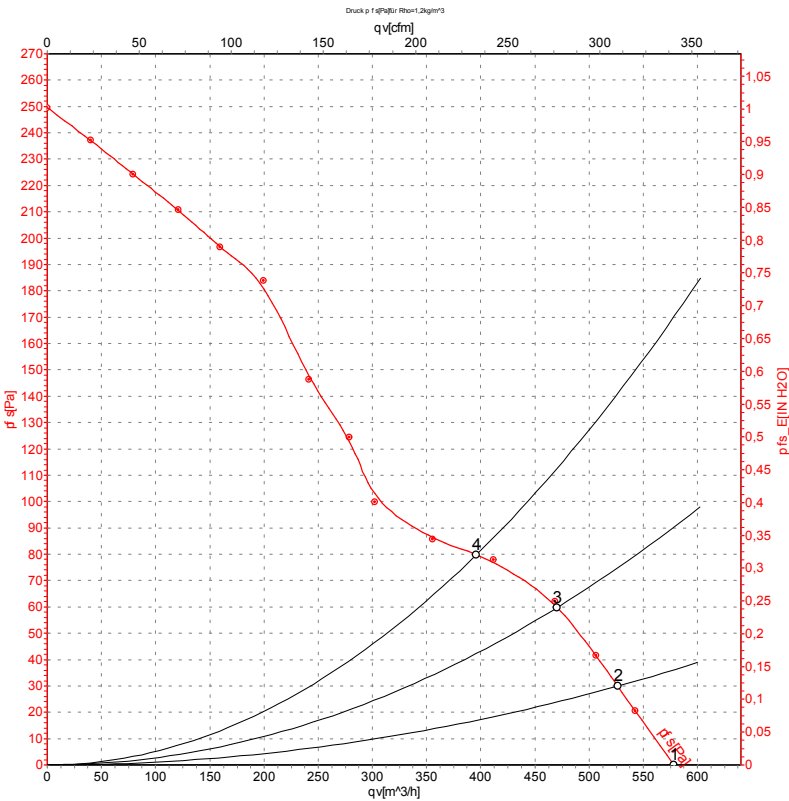

Measurement: LU-117214

Air performance measured as per ISO 5801
Installation category A. For detailed
information on the measuring set-up, please
contact ebm-papst. Suction-side noise
levels: LwA measured as per ISO 13347 /
LpA measured with 1m distance to fan axis.
The values given are valid under the
measuring conditions mentioned above and
may vary according to the actual installation
situation. With any deviation from the
standard set-up, the specific values have to
be checked and reviewed with the unit
installed.

Measured values


	U	f	n	P _e	I	qv	p _{fs}
	V	Hz	min ⁻¹	W	A	m ³ /h	Pa
1	230	50	2650	51	0.25	580	0
2	230	50	2650	52	0.25	525	30
3	230	50	2640	52	0.25	470	60
4	230	50	2640	52	0.25	395	80

U = Supply voltage · f = Frequency · n = Speed · P_e = Power input · I = Current draw · qv = Air flow · p_{fs} = Pressure increase



AC axial fan
straight blades (A series)

Charts: Air flow 60 Hz

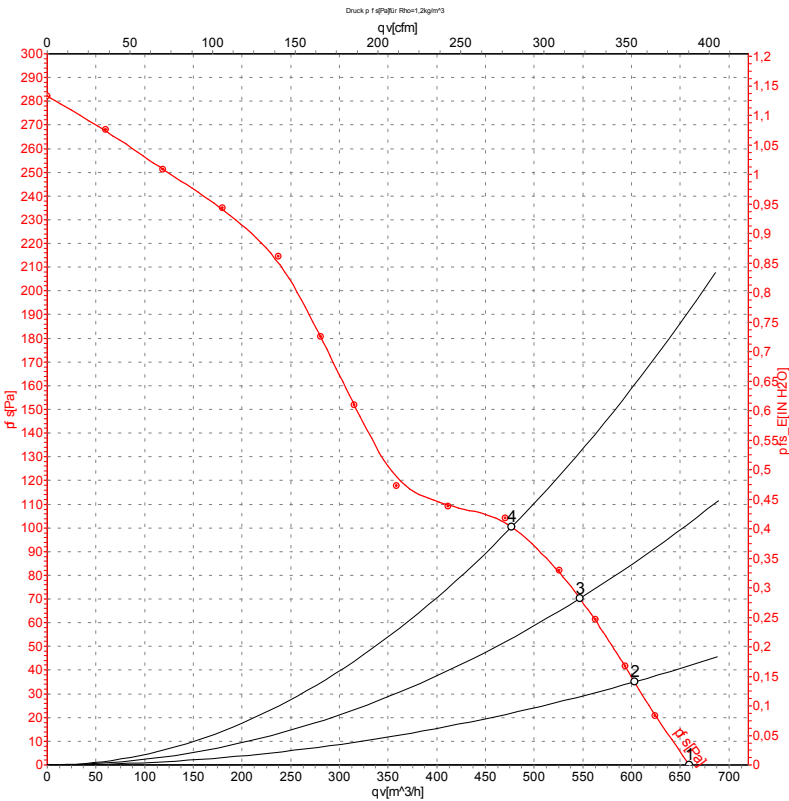

Measurement: LU-117218

Air performance measured as per ISO 5801
Installation category A. For detailed
information on the measuring set-up, please
contact ebm-papst. Suction-side noise
levels: L_{WA} measured as per ISO 13347 /
L_{pA} measured with 1m distance to fan axis.
The values given are valid under the
measuring conditions mentioned above and
may vary according to the actual installation
situation. With any deviation from the
standard set-up, the specific values have to
be checked and reviewed with the unit
installed.

Measured values

	U	f	n	P _e	I	qv	p _{fs}
	V	Hz	min ⁻¹	W	A	m³/h	Pa
1	230	60	3030	63	0.28	660	0
2	230	60	3005	65	0.28	605	35
3	230	60	2990	66	0.29	545	70
4	230	60	2985	66	0.29	475	100

U = Supply voltage · f = Frequency · n = Speed · P_e = Power input · I = Current draw · qv = Air flow · p_{fs} = Pressure increase

